



**PRECAST CONCRETE TROUGH SLAB**  
(6" THICK)

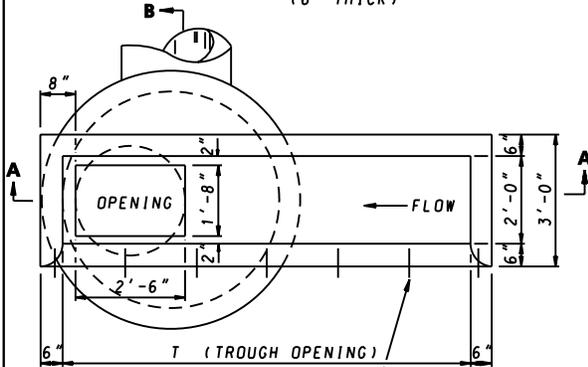

**PLAN**  
(SHOWN WITHOUT TROUGH SLAB)

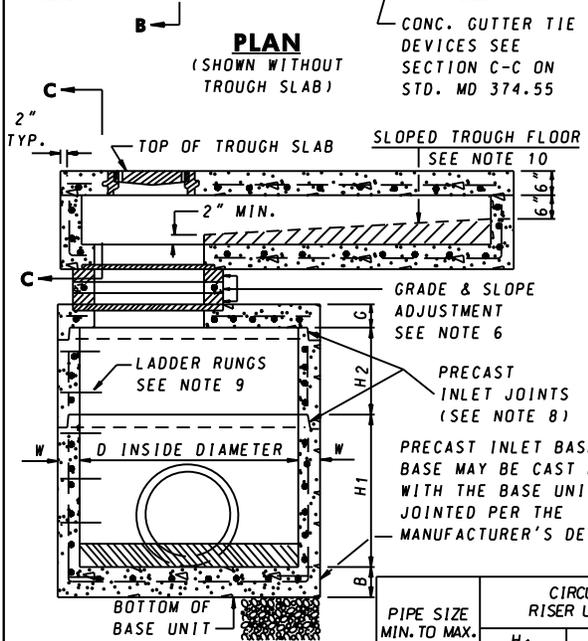


**SECTION A-A**  
(SHOWN PRECAST)

FOR SECTIONS C-C AND D-D SEE STD MD 374.55

INLET TYPE	T	L
COG-5	5'-0"	6'-0"
COG-10	10'-0"	11'-0"
COG-15	15'-0"	16'-0"
COG-20	20'-0"	21'-0"

**NOTES**

1. THIS STANDARD TO BE USED WITH TYPE A COMBINATION CURB AND GUTTER ONLY.
2. CURB OPENINGS SHALL NOT ENCRDACH ON CROSSWALK AREAS.
3. CONCRETE SHALL BE MIX. NO.6(4500 PSI) FOR PRECAST UNITS AND CONCRETE MIX NO.3(3500 PSI) FOR CAST IN PLACE UNITS.
4. INLET MAY BE PRECAST OR CAST IN PLACE. REINFORCEMENT SHALL BE EITHER WELDED WIRE FABRIC OR REINFORCING BARS AND SHALL CONFORM TO THE AREAS GIVEN UNDER R IN THE CHART ON THIS SHEET.
5. ANGLE IRON AND SHEAR STUD CONNECTORS SHALL BE GALVANIZED AFTER WELDING IN ACCORDANCE WITH ASTM A 123. SEE STDS. MD 374.55 & 374.64.
6. GRADE AND SLOPE ADJUSTMENTS SHALL BE COMPLETED IN THE FIELD USING PRECAST ADJUSTMENT COLLAR AND MORTAR.
7. A CONCRETE OR BRICK CHANNEL WHICH SLOPES AT LEAST 2 IN./FT. TOWARD OUTLET SHALL BE PROVIDED IN THE FIELD.
8. PRECAST INLET JOINTS-THE MANUFACTURER SHALL FORM MALE AND FEMALE ENDS OF JOINTS USING THEIR OWN DESIGN. THE JOINTS SHALL BE SEALED BY THE CONTRACTOR AND MADE WATERTIGHT USING THE MANUFACTURERS RECOMMENDED ASTM OR AASHTO APPROVED SEALANT.
9. LADDER RUNGS SHALL BE PLACED IN VERTICAL ALIGNMENT AT 1'-3" C/C. RUNGS SHALL BE IN ACCORDANCE WITH STANDARDS MD 383.91 OR MD 383.92. RUNGS ARE INCIDENTAL TO THE COST OF THE INLET.
10. SLOPED TROUGH FLOOR TO BE CONSTRUCTED IN THE FIELD USING BRICK OR CONCRETE AND USED ONLY WHEN ROAD GRADE IS 1.5% OR LESS.WHEN SLOPED TROUGH FLOOR IS USED, ROUGHEN PRECAST TROUGH FLOOR.
11. MINIMUM DEPTH PAYMENT PER EACH SHALL BE 6'-2" MEASURED FROM THE PIPE INVERT TO THE TOP OF THE TROUGH SLAB. VERTICAL DEPTH PAYMENT PER LINEAR FOOT SHALL INCLUDE ALL DEPTHS IN EXCESS OF 6'-2" INCLUDING ALL APPURTENANCES.
12. INLET SLAB NOT REQUIRED FOR 36" DIAMETER INLET. TROUGH SITS DIRECTLY ON TOP OF THE CIRCULAR UNIT. MORTAR AREA BETWEEN THE OUTSIDE WALLS OF THE TROUGH AND THE UNIT WALL.
13. SEE STD. MD 374.64 FOR ALTERNATE PRECAST COG TROUGHS AND STD. MD 374.65 FOR DEPRESSED GUTTER PAN DETAILS.
14. BASE UNIT WALLS MAY TAPER PER MANUFACTURER'S DESIGN.

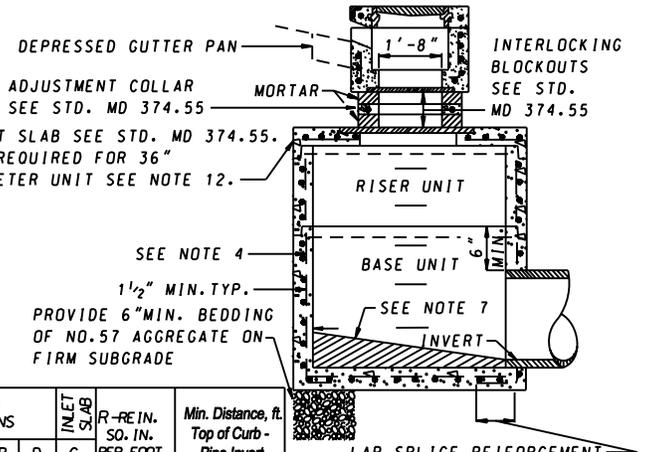

**SECTION B-B**  
(SHOWN PRECAST)

PIPE SIZE MIN. TO MAX.	CIRCULAR BASE AND RISER UNIT DIMENSIONS						INLET SLAB	R-REIN. SO. IN. PER FOOT	Min. Distance, ft. Top of Curb - Pipe Invert
	H <sub>1</sub> BASE	H <sub>2</sub> RISER	W MIN.	B	D	G			
12"	2' TO 4'	1' TO 4'	4"	6"	36"	NOT REQ.	.09	3.84	
15" TO 24"	3' TO 5'	1' TO 5'	5"	6"	48"	8"	.12	4.11-4.92	
27" TO 33"	3' TO 6'	1' TO 6'	6"	6"	60"	8"	.15	5.19-5.73	
36"	5' TO 6'	1' TO 6'	6"	6"	60"	8"	.15	6.00	
42"	5' TO 7'	1' TO 7'	7"	6"	72"	8"	.18	6.55	
48"	6' TO 7'	1' TO 7'	7"	6"	72"	8"	.18	7.09	
54"	6' TO 8'	1' TO 8'	8"	8"	84"	8"	.21	7.63	
60"	7' TO 8'	1' TO 8'	8"	8"	84"	8"	.21	8.17	
66" TO 72"	8' TO 9'	1' TO 8'	9"	8"	96"	8"	.24	8.71-9.25	
78" TO 84"	9' TO 10'	1' TO 8'	10"	8"	120"	8"	.27	9.80-10.34	

SPECIFICATION **305** CATEGORY CODE ITEMS

APPROVED *Kirk G. McCall*  
DIRECTOR - OFFICE OF HIGHWAY DEVELOPMENT



APPROVAL • SHA REVISIONS	APPROVAL • FEDERAL HIGHWAY ADMINISTRATION
APPROVAL 2-22-91	APPROVAL 1-2-91
REVISED 10-1-01	REVISED 8-16-91
REVISED 08-03-10	REVISED 07-26-10
REVISED	REVISED

**Maryland Department of Transportation**  
**STATE HIGHWAY ADMINISTRATION**  
STANDARDS FOR HIGHWAYS AND INCIDENTAL STRUCTURES  
**PRECAST OR CAST**  
**IN PLACE CIRCULAR COG INLETS**  
**5', 10', 15', & 20'**  
**STANDARD NO. MD 374.62**