



WIRING DIAGRAM

A.B.C.D.E
PUF



3-CONDUCTOR ELECTRICAL CABLE (NO. 14 AWG)
PROPOSED UNDERGROUND SERVICE TO BE INSTALLED
BY BG&E

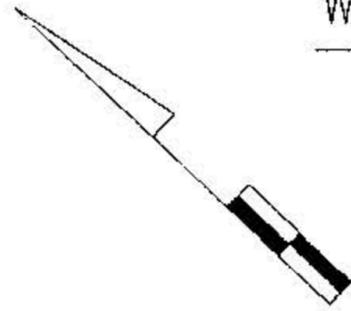

JACABSVILLE
VOL. FIRE DEPT.

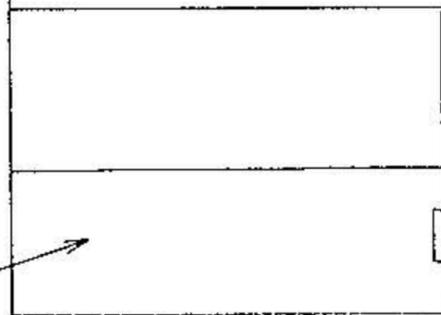

FOR WIRING INSIDE
OF FIREHOUSE, SEE
ATTACHED TYPICAL

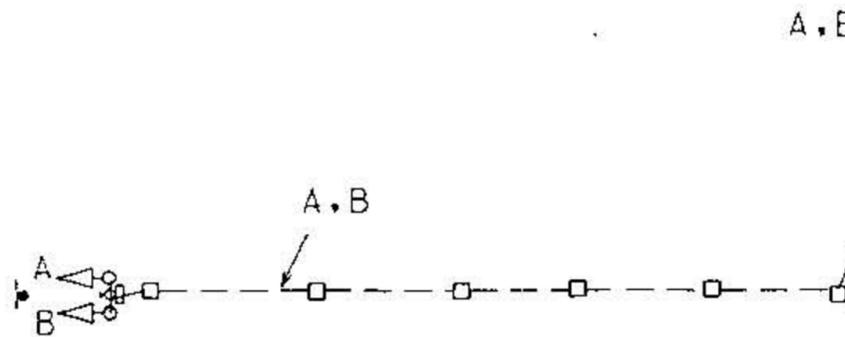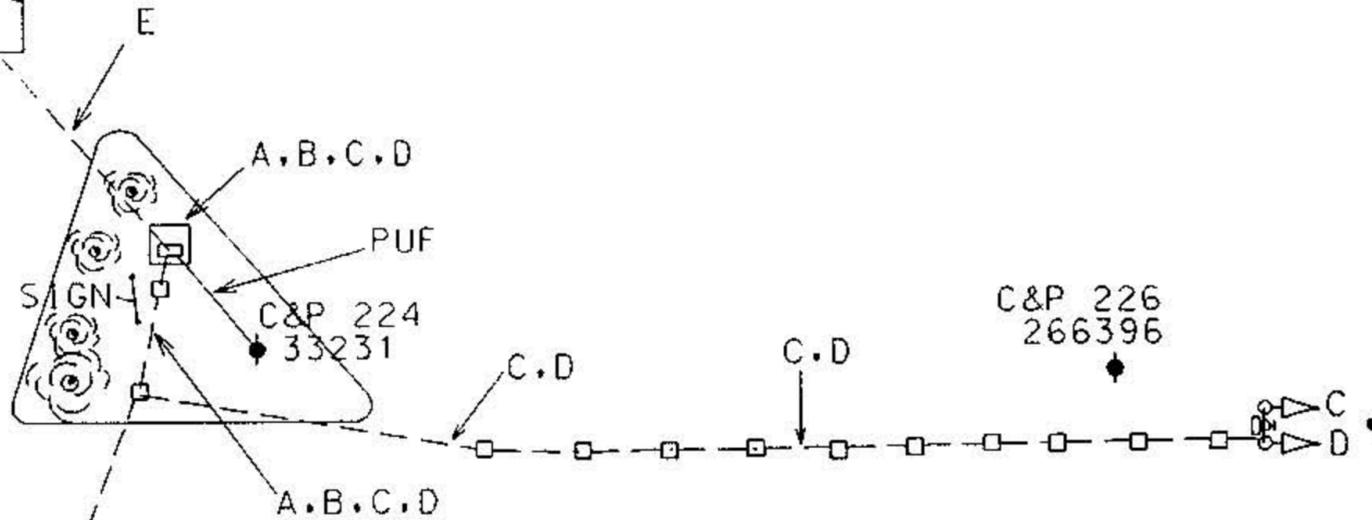

MARYLAND DEPARTMENT OF TRANSPORTATION OFFICE OF TRAFFIC & SAFETY TRAFFIC ENGINEERING DESIGN DIVISION		
MD 145 & JACKSONVILLE VOL. FIRE DEPT. BALTIMORE COUNTY TS # 4838,4839		
DATE 7-19-93	DRAWN BY MEL	CONTRACT NO.