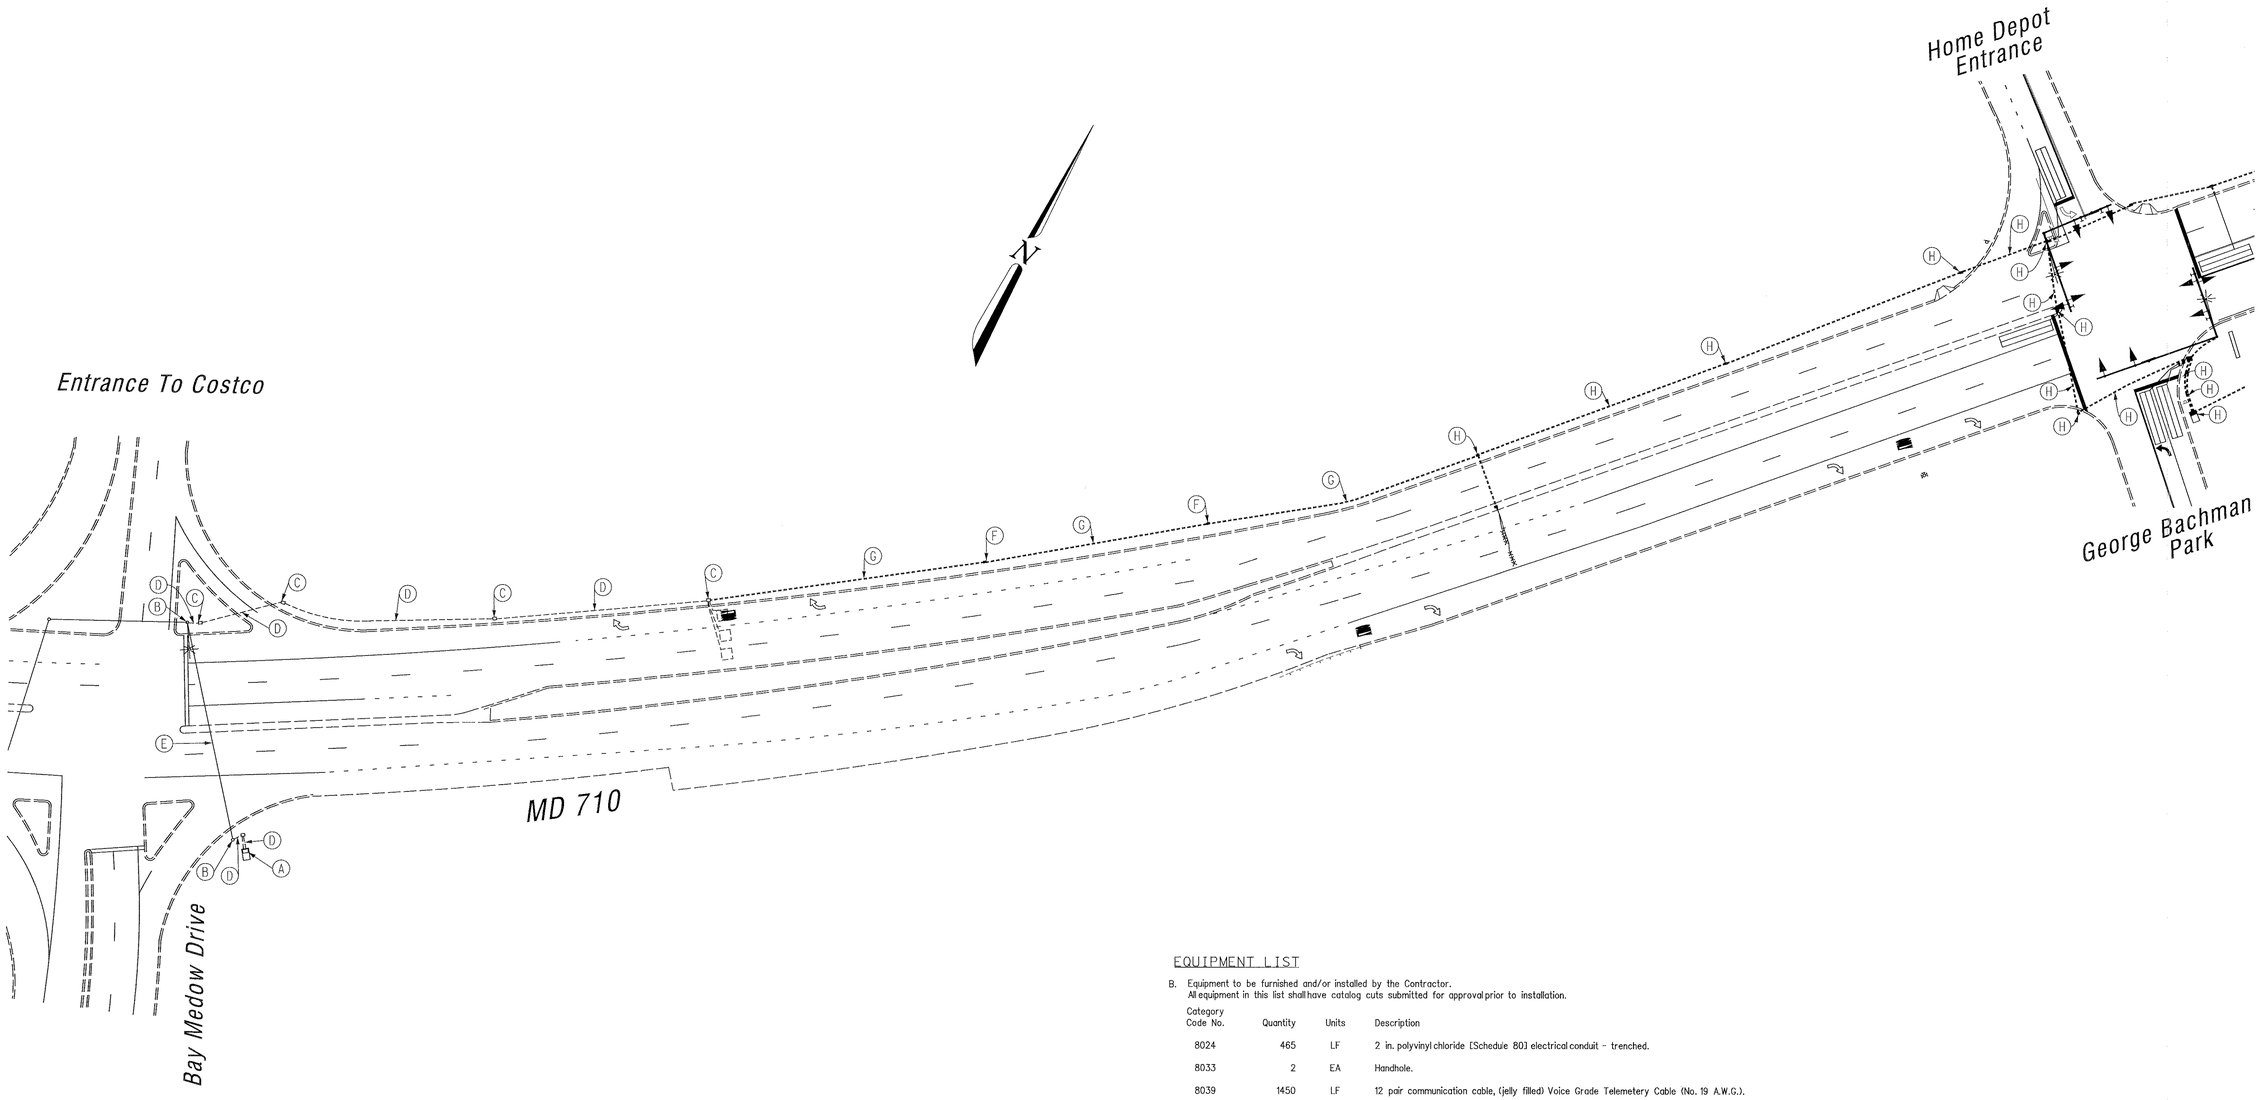

EQUIPMENT LIST

B. Equipment to be furnished and/or installed by the Contractor.
All equipment in this list shall have catalog cuts submitted for approval prior to installation.

Category Code No.	Quantity	Units	Description
8024	465	LF	2 in. polyvinyl chloride [Schedule 80] electrical conduit - trenched.
8033	2	EA	Handhole.
8039	1450	LF	12 pair communication cable, (jelly filled) Voice Grade Telemetery Cable (No. 19 A.W.G.).

GEOMETRIC LEGEND

EXISTING GEOMETRICS
PROPOSED GEOMETRICS

UTILITY LEGEND

G	GAS MAIN
W	WATER MAIN
S	SEWER MAIN
E	ELECTRIC CABLES
D	STORM DRAIN
A	AERIAL CABLES
T	TELEPHONE CABLES

CONSTRUCTION DETAILS

A. Use existing base mounted cabinet/controller.
B. Use existing steel strain pole.
C. Use existing handhole.
D. Use existing conduit.
E. Use existing span wire.
F. Install handhole.
G. Install 2 in. polyvinyl chloride [Schedule 80] electrical conduit - trenched.
H. Installed as part of traffic signal plan for MD 710 (Ordnance Rd) at George Bachman Park/Home Depot Entr.

The Traffic Group
The Traffic Group, Inc.
410-931-6600
Fax 410-931-6601

REVISIONS

APPROVALS

TEAM LEADER, TRAFFIC ENGINEERING DESIGN DIVISION

ASST. CHIEF TRAFFIC ENGINEERING DESIGN DIVISION

CHIEF, TRAFFIC ENGINEERING DESIGN DIVISION

DIRECTOR, TRAFFIC & SAFETY

MARYLAND DOT - STATE HIGHWAY ADMINISTRATION
Office of Traffic & Safety
TRAFFIC ENGINEERING DESIGN DIVISION
(Interconnect Signal Plan)
MD 710 from Bay Meadow Dr./Costco Entr. to George Bachman Park Entr./Home Depot Entr.

DRAWN BY: Frank Hoeckel	F.A.P. NO. N/A	TS NO. 4013	SHEET NO.
CHECKED BY:	S.H.A. NO. HD1053B51/B61	T.I.M.S. NO. D780	3 OF 3
SCALE: 1" = 40'	COUNTY: Anne Arundel		
DATE: June 21, 2000	LOG MILE:		

F:\970727\D41\dgn\Ec.dgn 21-JUN-2000