



# WIRING DIAGRAM



- A 3-CONDUCTOR ELECTRICAL CABLE (NO. 14 AWG)
- B,C,D 5-CONDUCTOR ELECTRICAL CABLE (NO. 14 AWG)
- POF PROPOSED OVERHEAD SERVICE TO BE INSTALLED BY BG&E

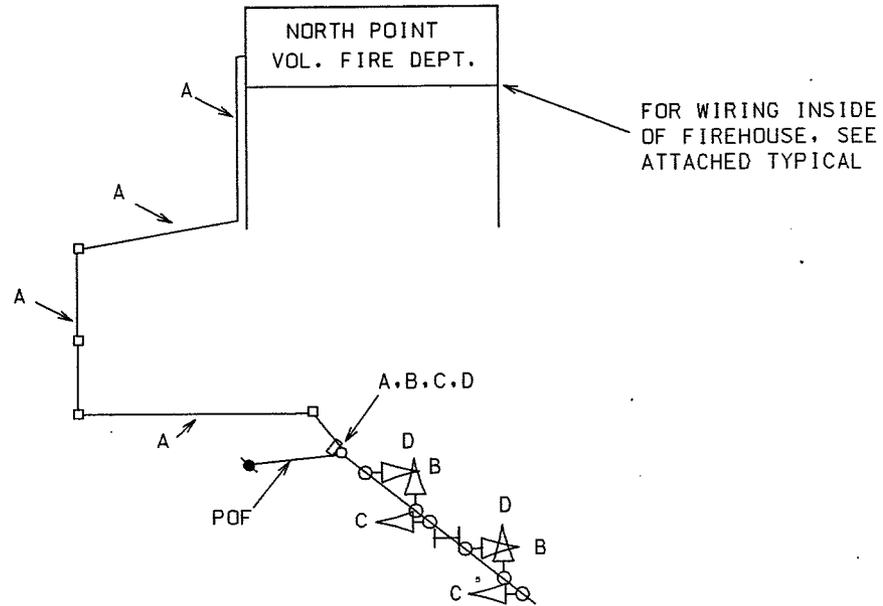

FOR WIRING INSIDE OF FIREHOUSE, SEE ATTACHED TYPICAL

TS # 4864

MARYLAND DEPARTMENT OF TRANSPORTATION  
OFFICE OF TRAFFIC & SAFETY  
TRAFFIC ENGINEERING DESIGN DIVISION

MD 261 & NORTH BEACH VFD  
CALVERT COUNTY

DATE 2-10-94	DRAWN BY MEL	CONTRACT NO. 855-25042139
-----------------	-----------------	------------------------------